



GALLON CAPACITY	*OUTSIDE DIMENSIONS			INLET TEE HGT. HGT.	OUTLET TEE HGT.
	LENGTH	WIDTH	HEIGHT		
3000	15'-7"	9'-7"	8'-6.5"	*VARIES BASED ON TANK SIZE	5'-0"
1500	11'-0"	6'-0"	4'-7"	3'-10"	4'-0"
1000	8'-6"	5'-3"	4'-6"	3'-10"	4'-0"
750	7'-0"	4'-8"	4'-6"	3'-10"	4'-0"

\*DIMENSIONS OF PREFAB CONCRETE TANKS MAY VARY BASED ON MANUFACTURER, HOWEVER THE GALLON CAPACITY MUST BE EQUIVALENT TO THE TANK SIZE SPECIFIED FOR INSTALLATION.

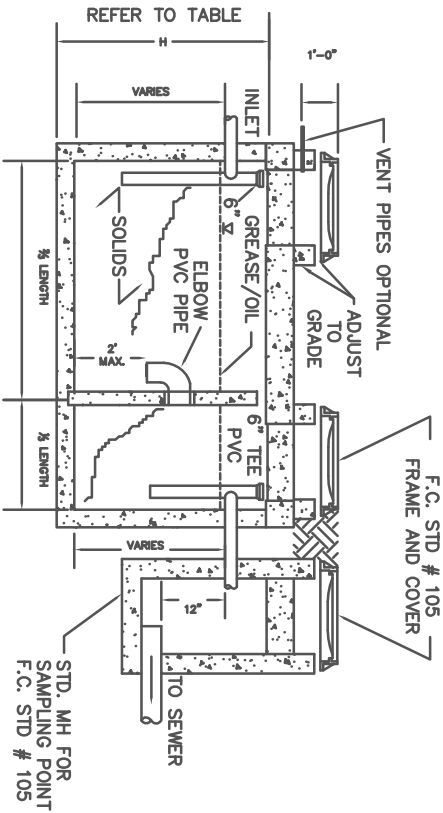

SECTION A-A  
N.T.S.



BAFFLE STANDS 50" IN HEIGHT  
AND IS 2 1/2" IN THICKNESS  
REINFORCED W/ 6-6-10 WIRE MESH  
PIPE DIAMETER MAY VARY  
STANDARD 3"-5"  
PVC PIPE REQ'D ON WALL  
WITH ELBOW TURNED DOWN MAX.  
2' OFF TANK BOTTOM  
\* BAFFLE WALL OPTIONAL ON  
SINGLE TANK INSTALLATIONS.

BAFFLE WALL\*  
N.T.S.

FULTON COUNTY STANDARD DETAIL 702  
SINGLE TANKS

DATE	REVISIONS	DATE	REVISIONS	DGS/DRN/CHKD: JM	FULTON COUNTY PUBLIC WORKS	DRAWING NO.
8/08	NRR			APPROVED: REW	141 PRYOR ST. ATLANTA, GA. 30303	702
				DATE: 12-2-05	404-612-7400 FAX: 404-224-0498	